

HZBB- II

HZBB-II

赫兹电力
HERTZ POWER



服务宗旨：快速响应，**客户满意，超过期望**


!@%&*^_`~|{|}~#~\$~%~&~*~() ~+ , - . / : ; < = > ? [\] ^ _ { | } ~ ! @ # \$ % & * () + , - . / : ; < = > ? [\] ^ _ { | } ~

赫兹电力
HERTZ POWER

赫兹电力
HERTZ POWER



4

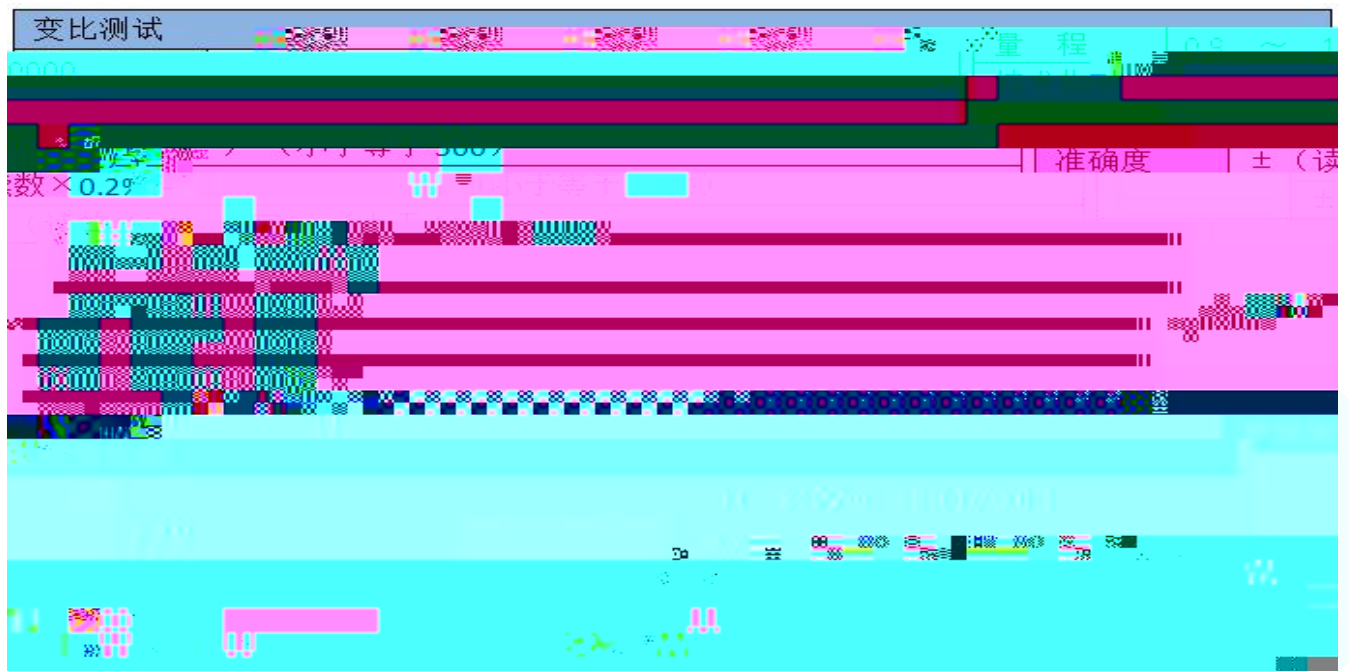

5

6



Ä



三相测试

单相测试

Z 型测试

存储查询

时钟设置

厂家设置

三相测试

盲测功能

2017/11/24 星期五 17:33:46

三相测试 > 盲测功能 > 参数设置

试品编号 000000

<说明>

3

设置试品编号。

额定高压 222.50kV

额定低压 35.00kV



”

“ ”

φ

ь Р /

lJ n

“

“

P

“ ”

“


”

“ ”



	“ ”

“ ”	
-----	--

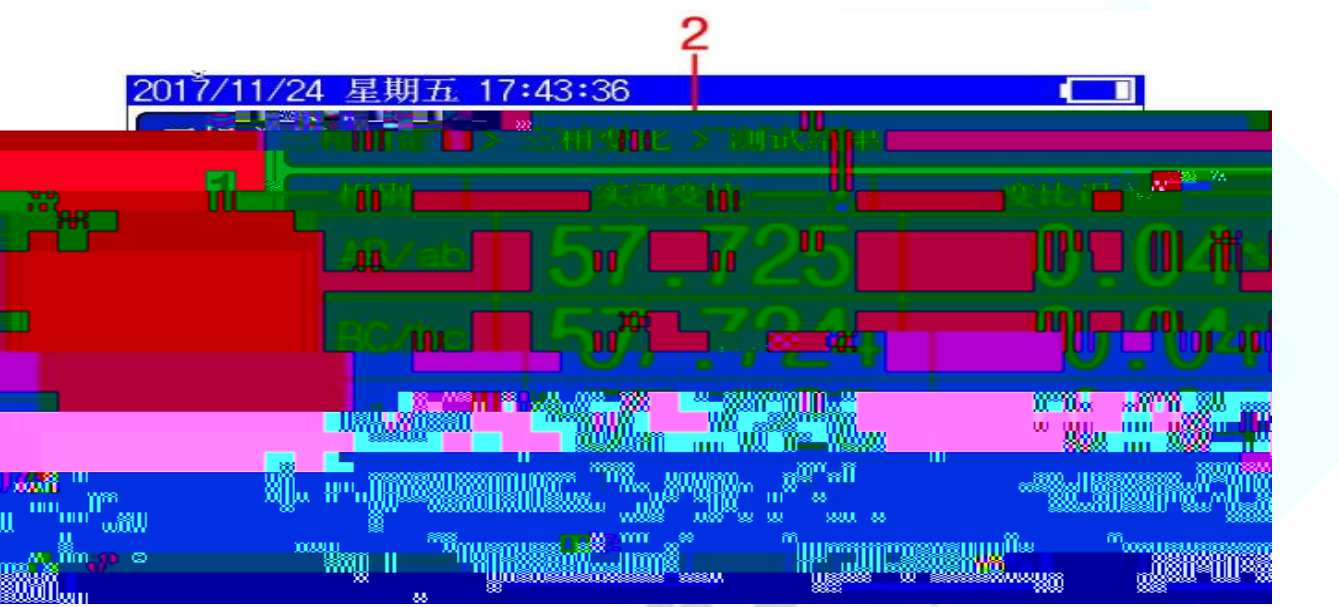

	“ ” “ ” “ ”
继续测试	
打印数据	
保存数据	



8

19

9 10 11

9 12

2

1

Y--d

√ D--y

√

”

“

”

“

1

2

1.



2.

☐ ☐ ☐ ☐

1

2

3

2

24

027-83267669

24

48

4