

1
2
3
4
5
6
7
8
9

A

9

B

11

1

C κ Ÿ C R

m "

Q/GDW 12154 2021

4.1

4.2

4.2.1

4.2.2

4.3

4.4

1

2

4.5

4.6

4.6.1

4.6.2

4.7

4.7.1

4.7.2

5

5.1

5.2

5.2.1

5.2.1.1

5.2.1.2

5.2.2

5.2.2.1

5.2.2.2

5.2.3

5.2.3.1

Q/GDW 12154 2021

5.2.3.2

5.2.3.3

6

6.1

6.1.1

6.2.1.1

4

6.2.1.2

6.4 220kV

V m "

7 220kV

Q *

--

7

7.1

7.1.1

7.1.2

7.1.3

7.1.4

7.1.5

7.1.6

7.2

A

A.1

A.2

A.1

A.1

A.3

A.3.1

A.2

A.2

A.3.2

A.3

A.3

A.4

A.4

A.4

B

B.1

B.1.1

B.1.2

A

B.2

B.1

B.1

B.3

B.3.1

B.2

B.2

B.3.2

B.3

B.3

B.4

B.4

B.4

C

C.1

C.1

C.1

					m ²
1				(0~20000)N, ≥ 5kHz, 2.5 5 ₀ ^{+0.01} kg 48mm 45#	≥ 15
				45# , 3 ₀ ^{+0.05} kg, : 60 ° , 0.5mm, 40mm, 28mm, HRC45	
2				20kN, ≥ 800mm 1.0	≥ 15
3				20kN, ≥ 800mm 1.0	
4				20kN, ≥ 800mm 1.0	
5				\	\

C.1

					m ²
6				20kN ≥ 800mm 1.0	≥ 15
7				20kN ≥ 800mm 1.0	
8				≥ 50mΩ 1 ≥ 30A	≥ 15

C.2

C.2

C.2

					m ²
1	35kV			DL/T 740	≥ 50
				≤ 50kV 1	
			1		
				150kV 1	
2	66kV~220kV			DL/T 740	≥ 100 10m
				150kV 1	
			1		
				500kV 1	

C.2

								m ²
					DL/T 740			
3	330kV			1	500kV	1	≥ 300	20m
					1500kV	1		
					DL/T 971			
4				1	50kV	1		
					100kV	1		
5	35kV			1	≥ 50mΩ	1	≥ 30A	
					"			
		0 đ			100kV	1		
6	66kV~220kV	m			≥ 50mΩ	1	≥ 30A	
		NÁ						

C.2

					m ²
8	() 35kV		1		
				150kV 1	
9	() 66kV~220kV		1		
				500kV 1	
10	() 330kV		1		
				1500kV 1	
				1000kV 1	
11				0.5m	≥ 50
				150kV 1	
12				50kV 1	≥ 30
				DL/T 1476	
13				100kV 1	

C.3

C.3

C.3

					m ²
1				50kV 1	≥ 30
			1		
				50kV 1	
				30mA 1	
2				50kV 1	
			1		
				50kV 1	
				30mA 1	
			1		
3				50kV 1	≥ 30
				DL/T1476	

C.4

C.4

C.4

					m ²
1				5kN, 1, AC220V	≥ 15
2				5kN, 1, AC220V	
3				5kN, 1, AC220V	
4				300kN/20kN 15m , 1.2m 1.0	
5				5kN, 1, AC220V	
				(5Kg/10kg, 3%, 300kg)	
6				5kN, 1, AC220V	
				(5Kg/10kg, 3%, 300kg)	
				1T	

D


D.1

D.2- D.7


D.1

D.1


D.1

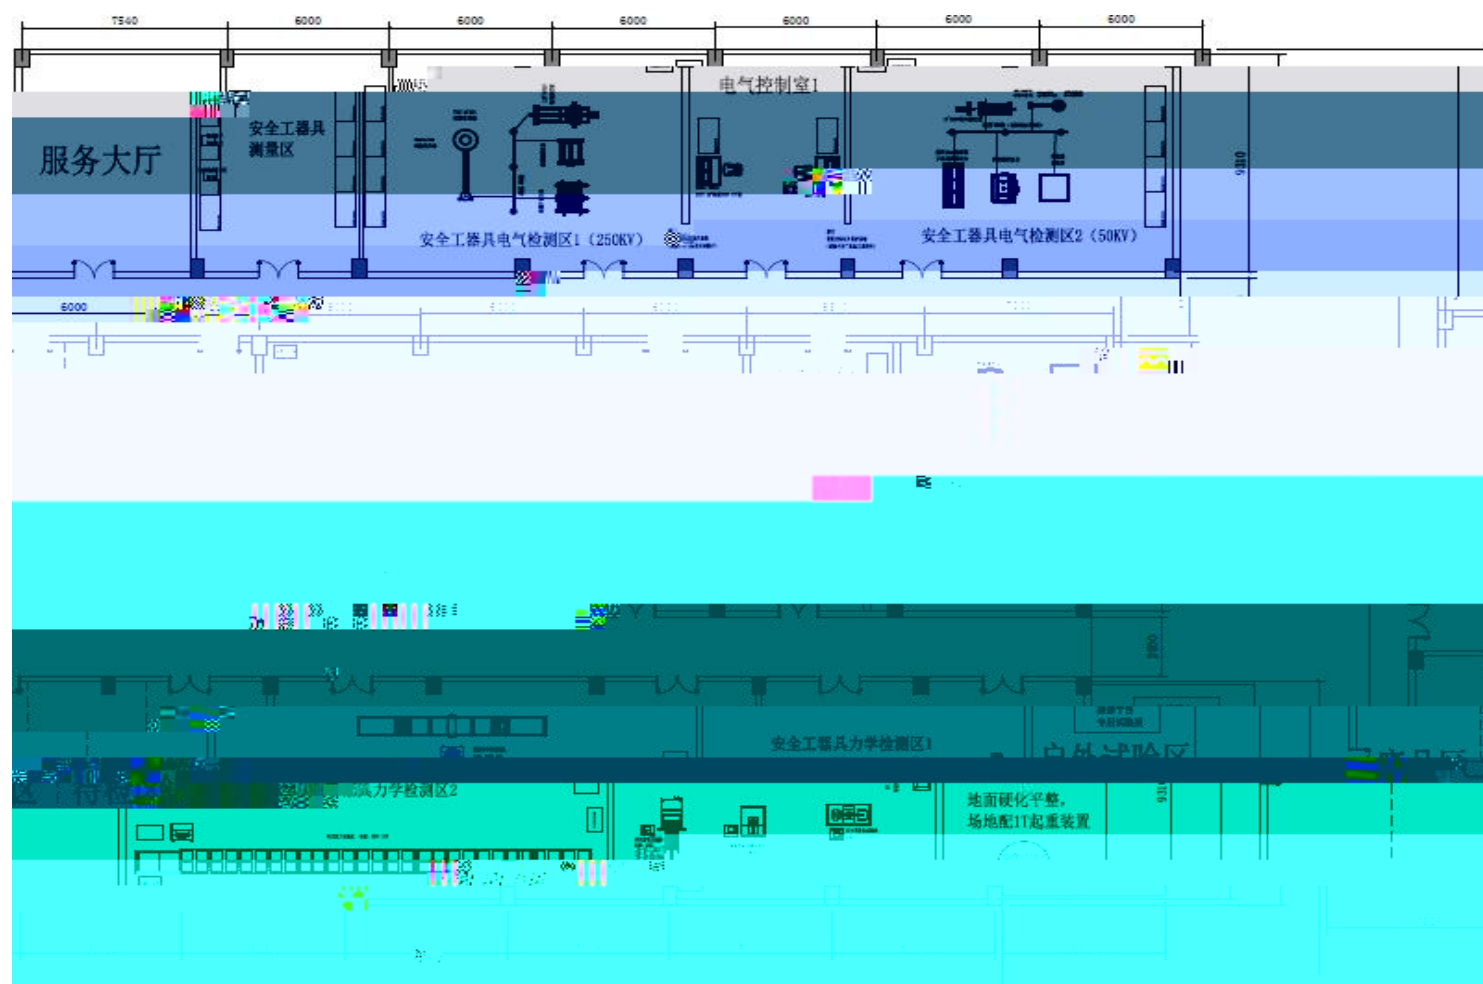


D.1 **

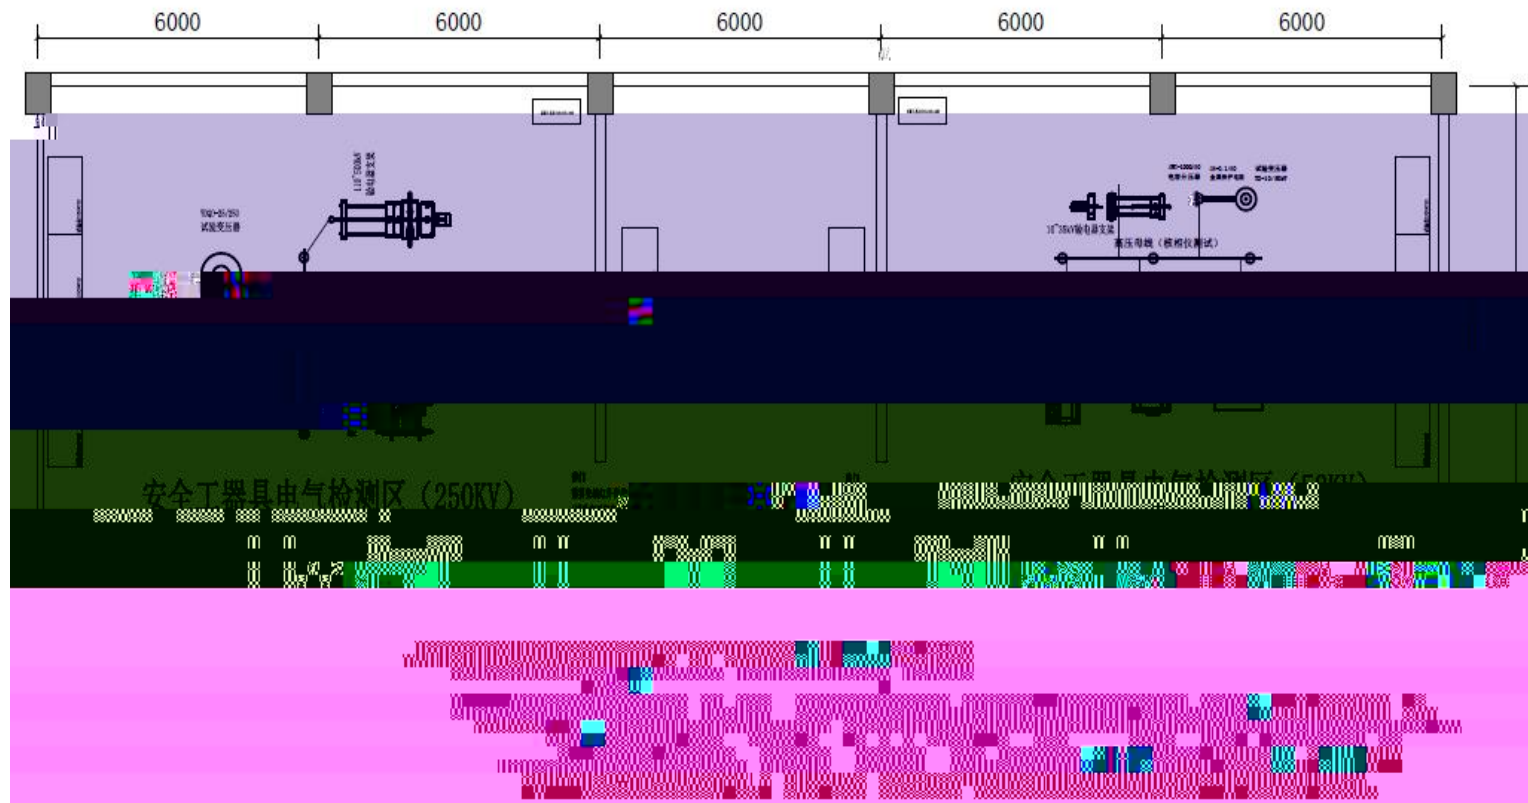


D.2

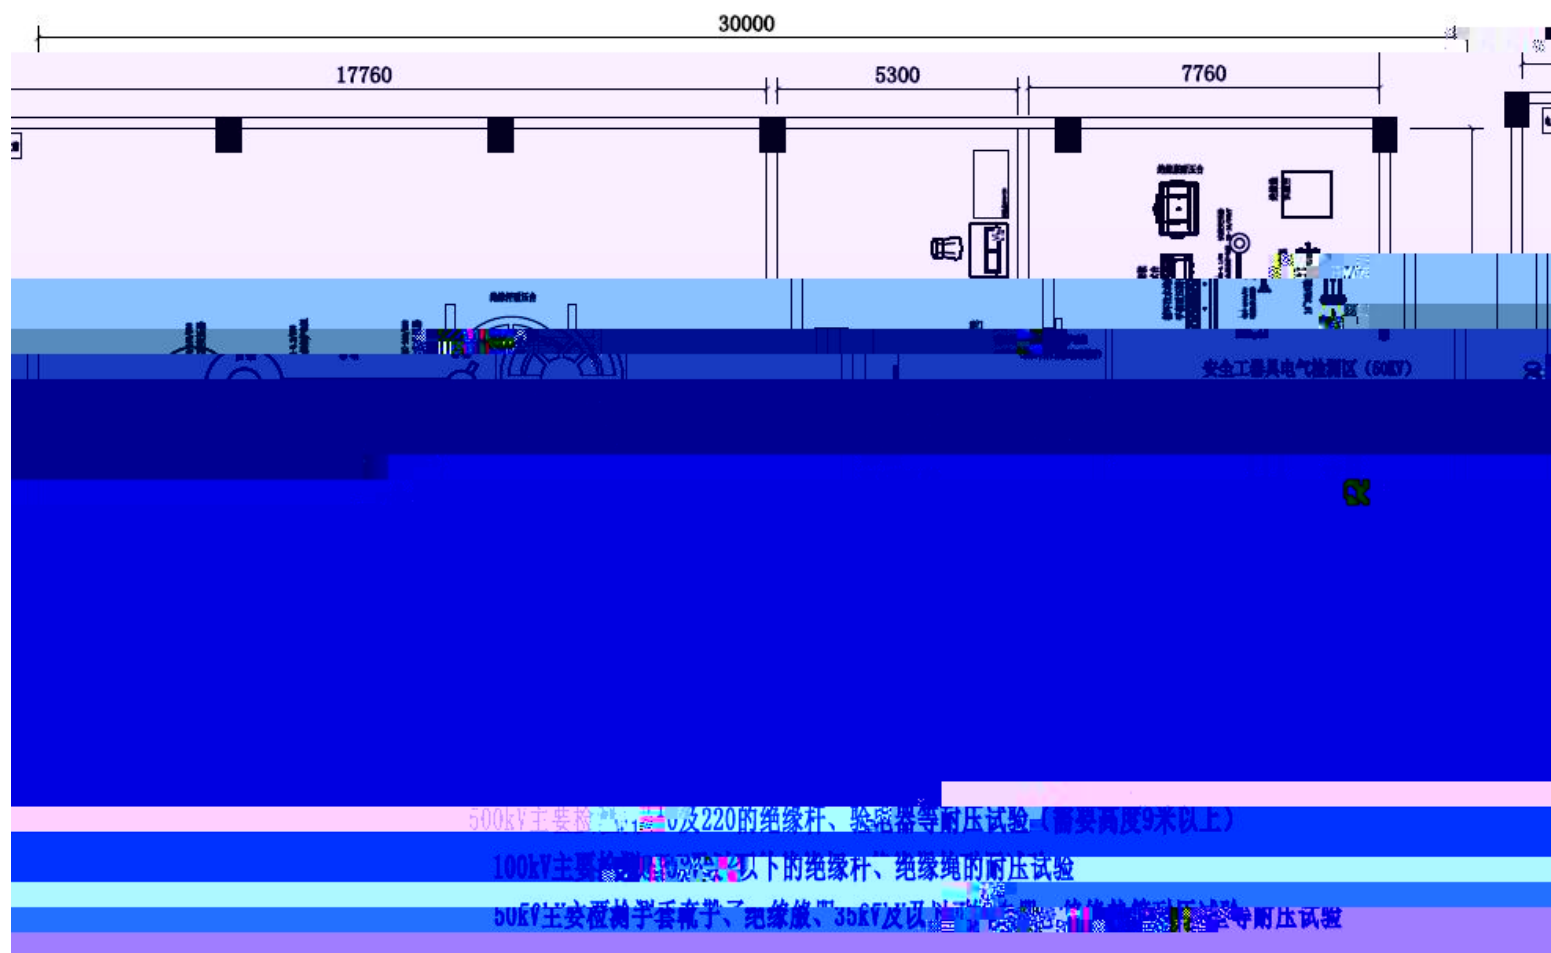

D.3

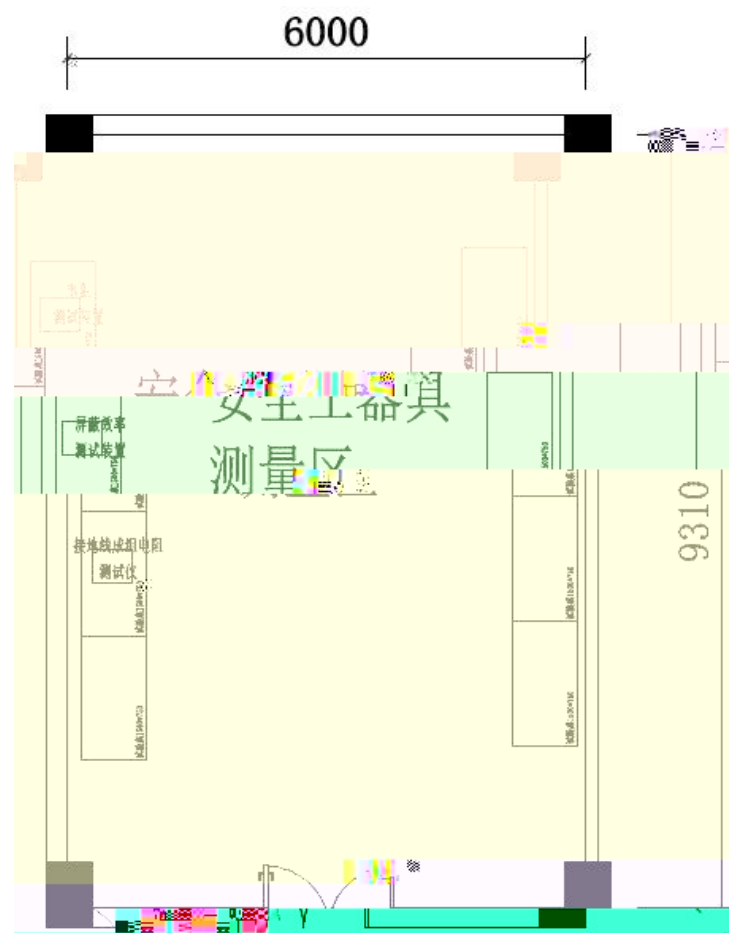


D.4

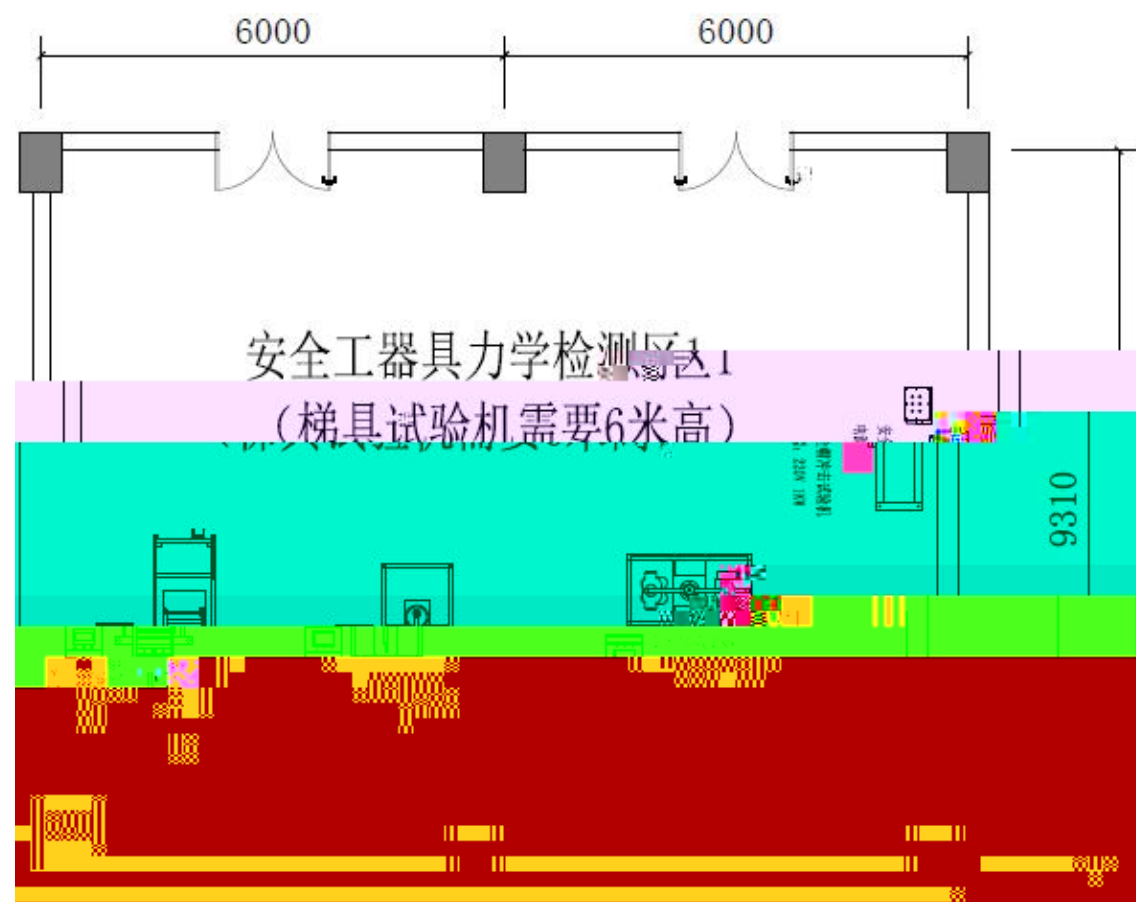

D.5

1



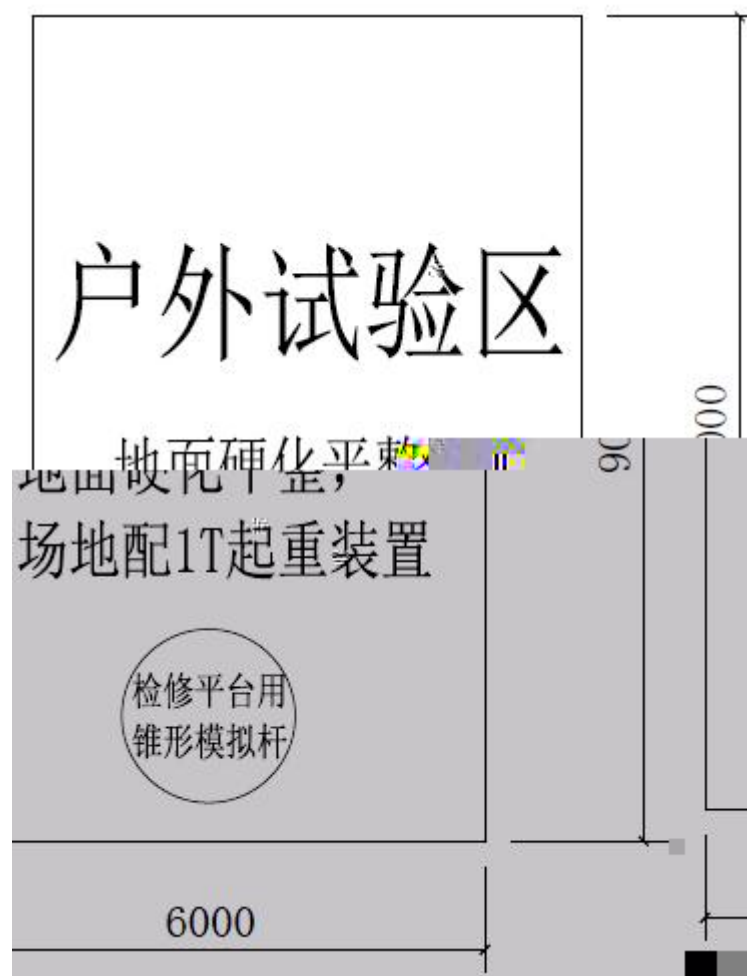

D.7


E

E.1

E.2

E.2.1

E.2.2

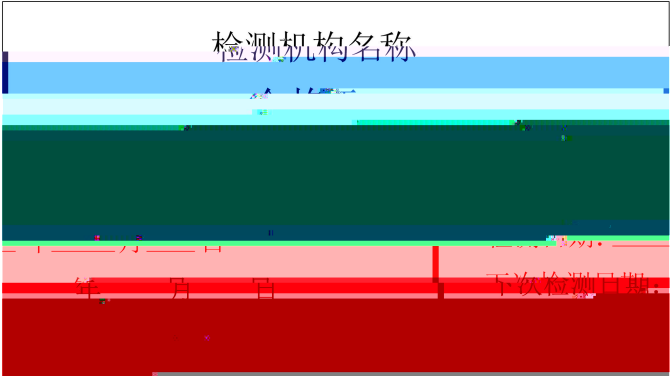


E.1

E.2.3

E.3

E.2-E.4

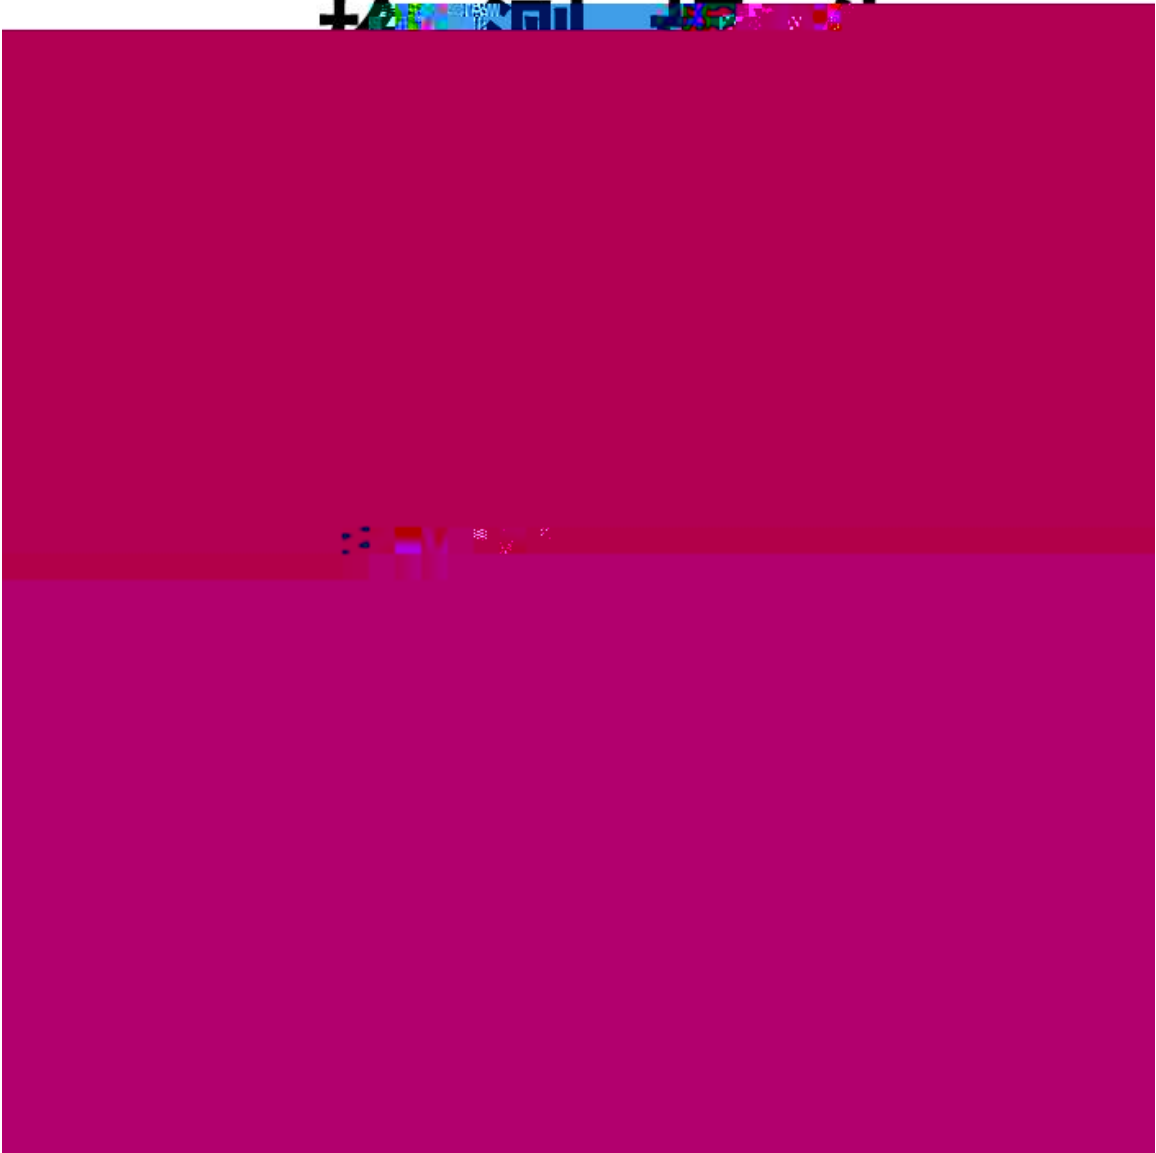

E.2

检测结果

序号	检测项目	标准	检测结果	评价
1	绝缘杆 工频耐压试验	试验长度：2.1m； 试验时间：1min； 试验电压：440kV		

报告正文

绝缘杆工频耐压试验

t = °C RH= % P= kPa K ₁ =								
试品编号	系统额定电压 (kV)	试验距离 (m)		试验时间 (min)		试验电压 (kV)		评价
		标准值	试验值	标准值	试验值	标准值	试验值	
	220	2.1		1		440×K ₁		
	220	2.1		1		440×K ₁		
	220	2.1		1		440×K ₁		
备注								

E.4

1	34
2	34
3	34
4	34
5	34
6	35

C

Q/GDW 12154 2021

1

4

“ ”